



Distribution Patterns:

Models V2725, V2726
K5.6 Standard Conventional
Pendent Position Distribution Patterns – Trajectory

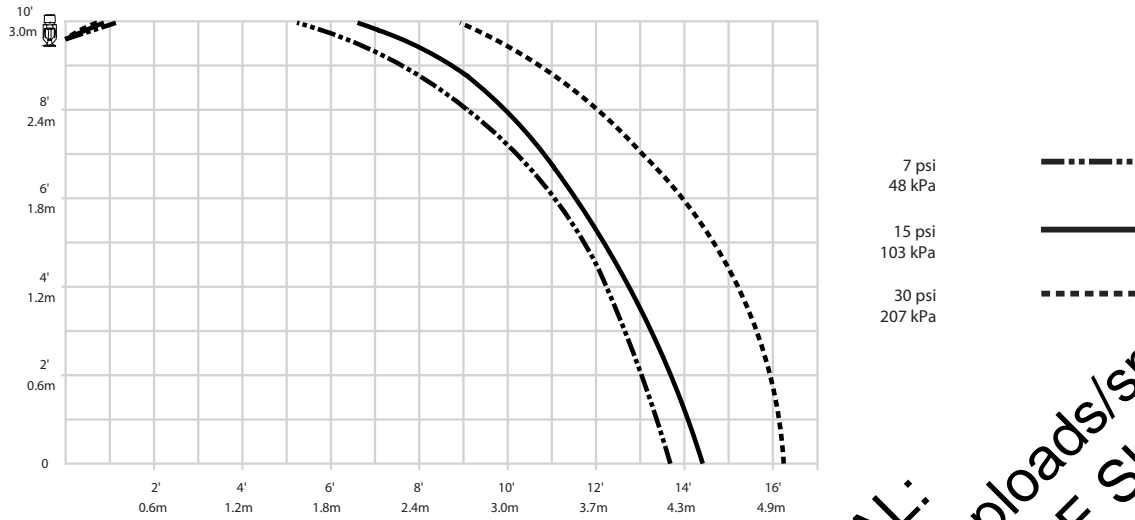

Models V2725, V2726
K5.6 Standard Conventional
Upright Position Distribution Patterns – Trajectory

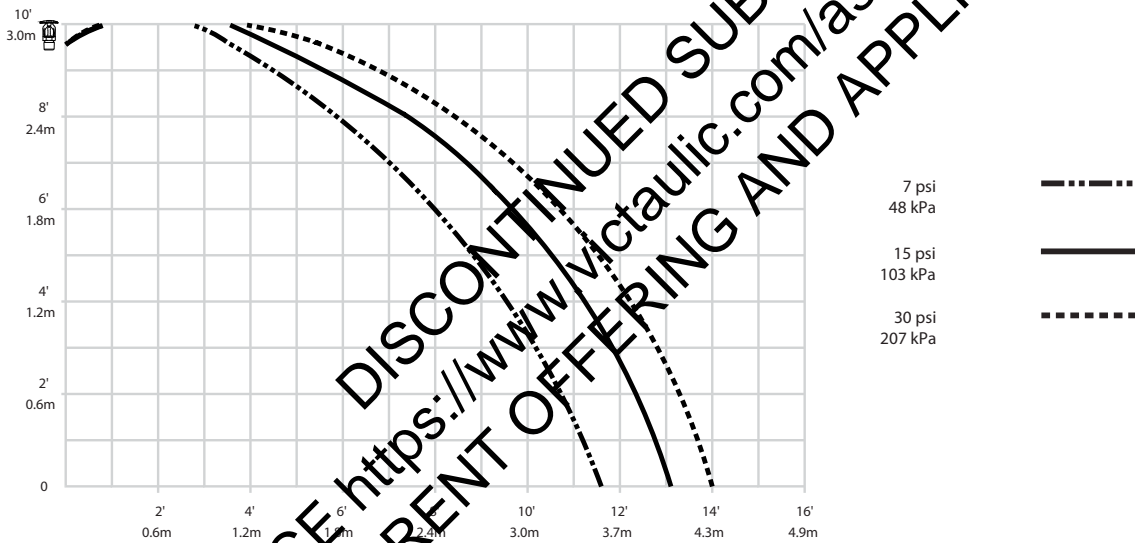

NOTES:

- A. Data shown is approximate and can vary due to differences in installation.
- B. These graphs illustrate approximate trajectories, floor-wetting and wall-wetting patterns for these specific Victaulic FireLock automatic sprinklers. They are provided as information for guidance in avoiding obstructions to sprinklers and should not be used as minimum sprinkler spacing rules for installation. **Refer to the appropriate NFPA National Fire Code of the authority having jurisdiction for specific information regarding obstructions, spacing limitations and area of coverage requirements.** Failure to follow these guidelines could adversely affect the performance of the sprinkler and will void all Listings, Approvals and Warranties.
- C. All patterns are symmetrical to the centerline of the waterway.

REFERENCE DISCONTINUED SUBMITTAL:
 FOR OUR CURRENT OFFERING AND APPLICABLE SUBMITTALS
<https://www.victaulic.com/assets/uploads/sprinklers>

